


COMBI-PRO-MAX-2P 2.1

CORTE DE NEUTRO
NEUTRAL SEPARATED
AVEC COUPURE DU NEUTRE

Control backup con protección de sobretensión
Backup control with overvoltage protection
Commande backup avec protection contre le surtension

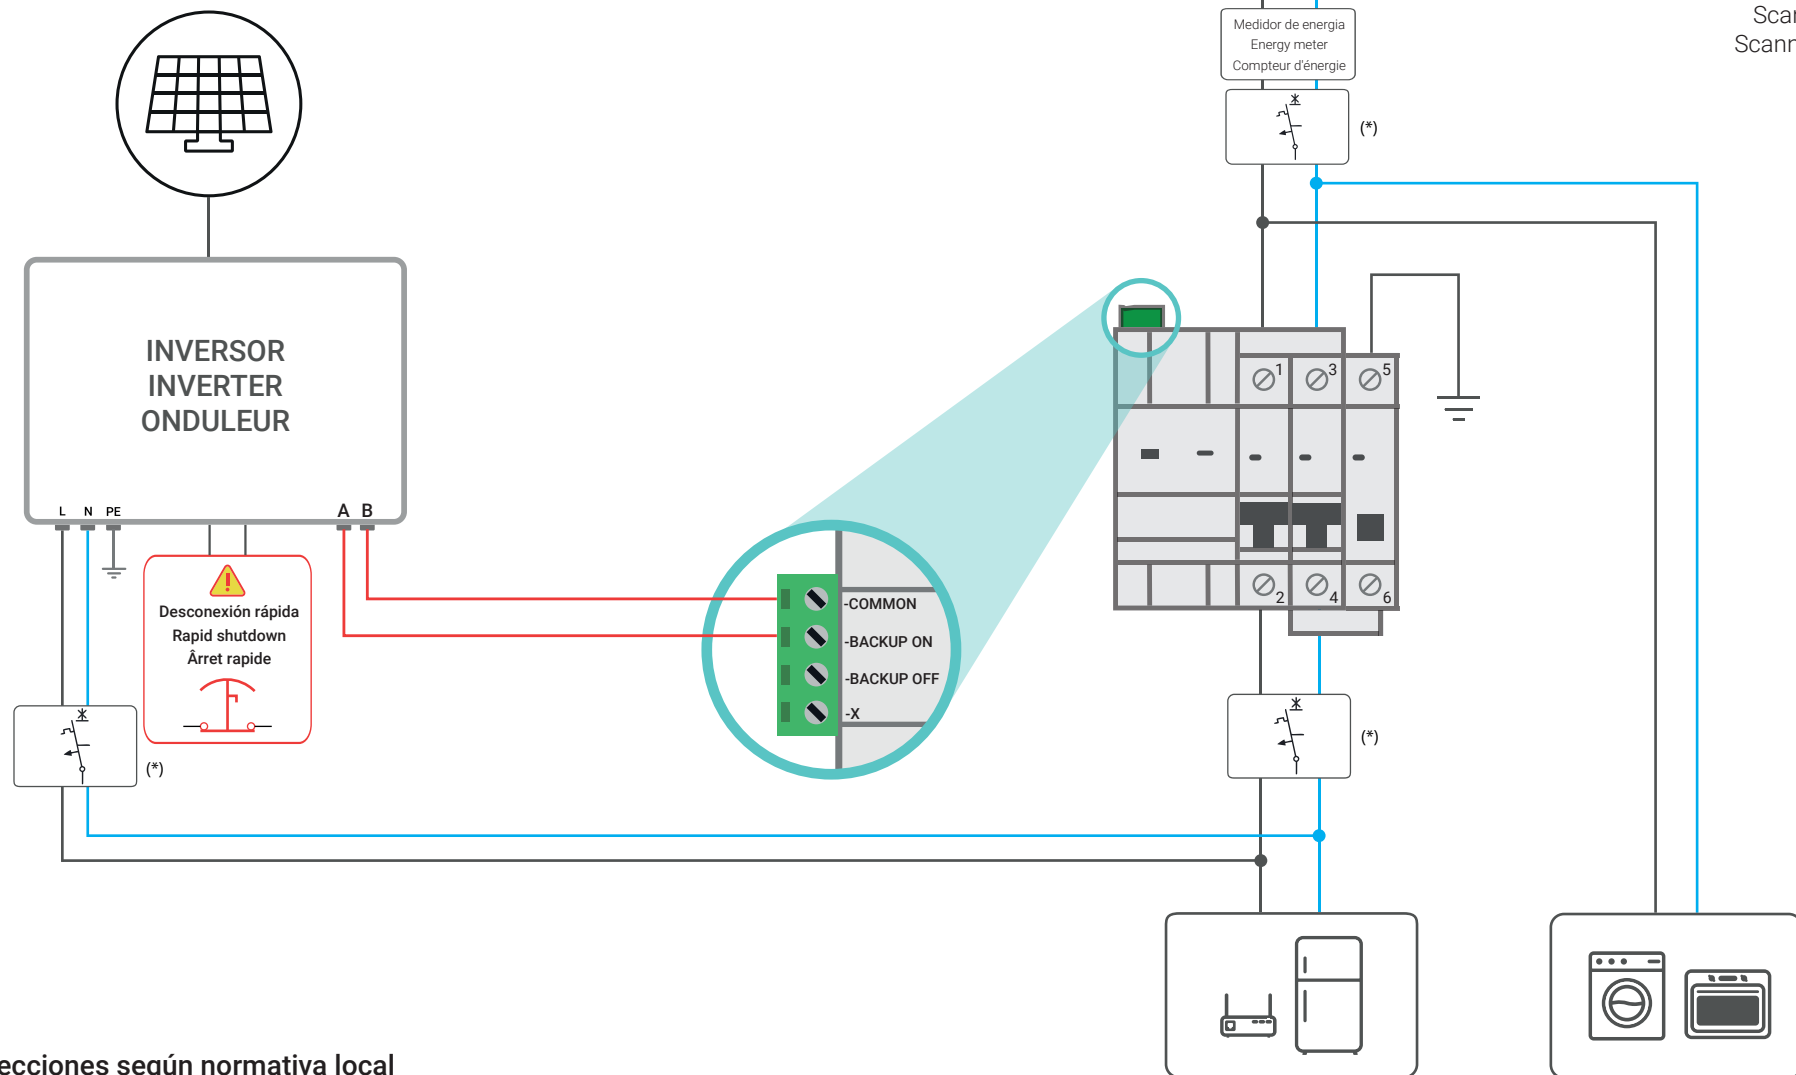

Escanea
Scan
Scannez

- (*) Protecciones según normativa local
- (*) Protection device according to local regulations
- (*) Protections conformes à la réglementation locale

Cargas críticas
Critical loads
Charges critiques

Cargas no esenciales
Non-essential loads
Charges non essentielles

Terminales Backup del inversor Backup inverter terminals Terminaux backup de l'onduleur		
INVERSOR INVERTER ONDULEUR	A	B
HUAWEI SUN2000-(2KTL...6KTL)-L1 SUN2000-(8K...10K)-LC0 SUN2000-(3K...6K)-LB0	5 GND	8 DI2
KOSTAL PLENTICORE MP G3 (Necesita resistencia de 6,8 kΩ) (Requires a 6.8 kΩ resistor) (Nécessite une résistance de 6,8 kΩ)	GND	In1
GROWATT MIN-(2500...6000)-TL-XH	8	3
SIGENERGY SIGEN Hybrid (2.0...6.0) SP2	GND	D1