


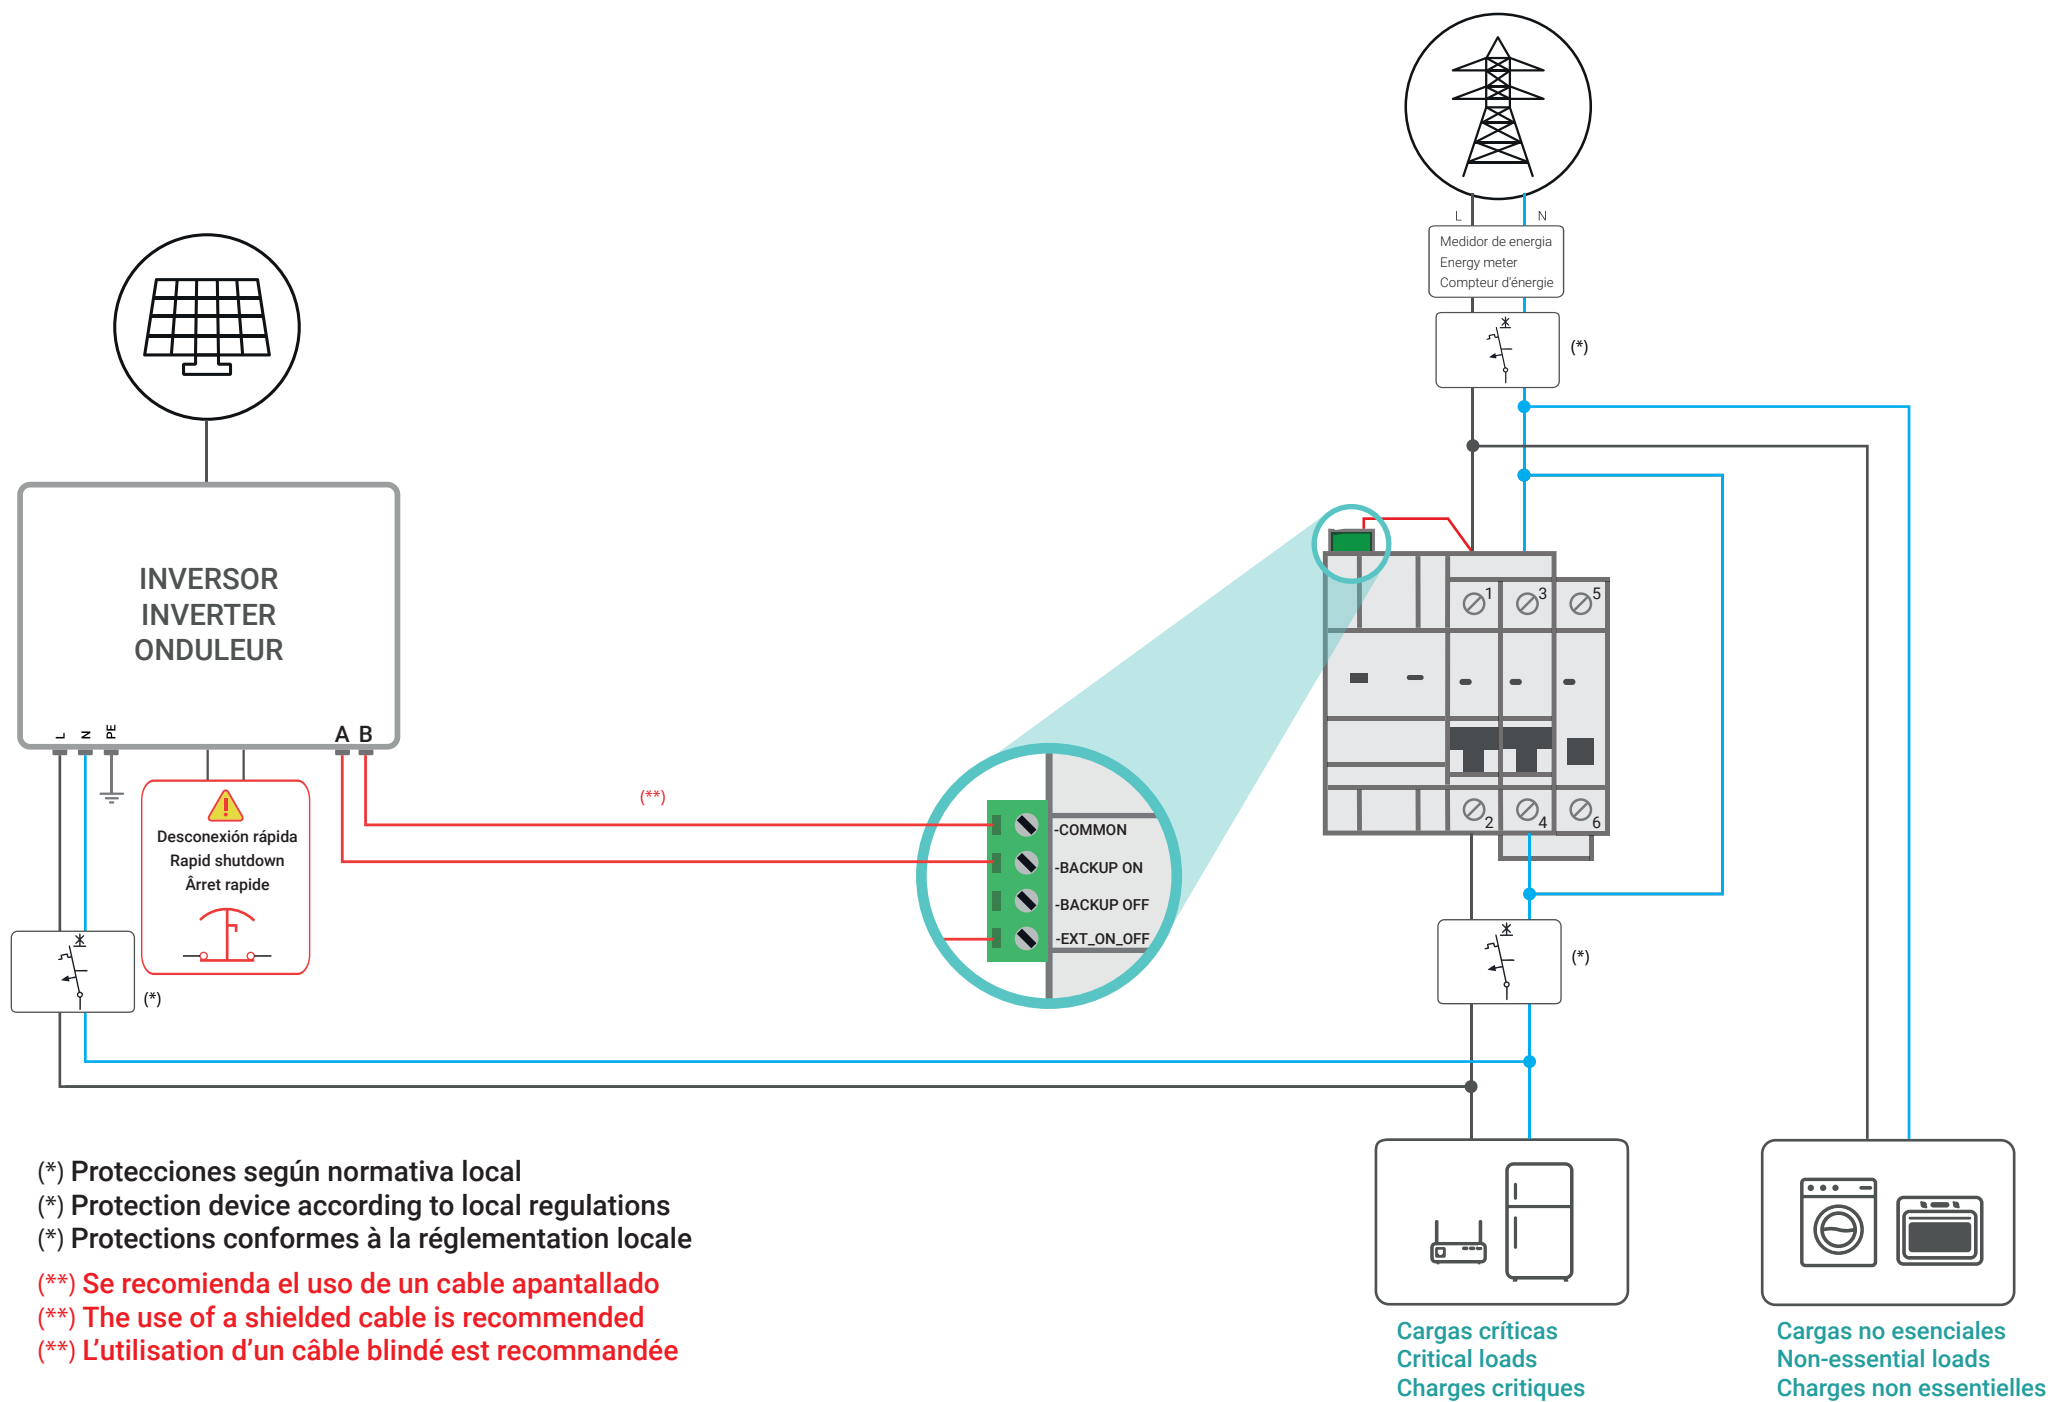

Terminales Backup del inversor Backup inverter terminals Terminaux backup de l'onduleur		
INVERSOR INVERTER ONDULEUR	A	B
HUAWEI SUN2000-(2KTL...6KTL)-L1 SUN2000-(8K...10K)-LC0 SUN2000-(3K...6K)-LB0	5 GND	8 DI2
KOSTAL PLENTICORE MP G3 (Necesita resistencia de 6,8 kΩ) (Requires a 6.8 kΩ resistor) (Nécessite une résistance de 6,8 kΩ)	GND	In1
GROWATT MIN-(2500...6000)-TL-XH	8	3
SIGENERGY SIGENSTOR SP SIGEN HYBRID SP2	DI1	GND